




ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss



DHP-L Opti Pro +6



A++

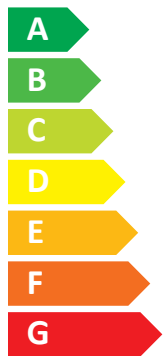

A



2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss

DHP-L Opti Pro +6





55 °C

35 °C



A++

A++

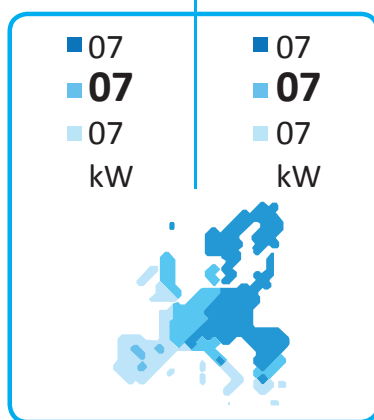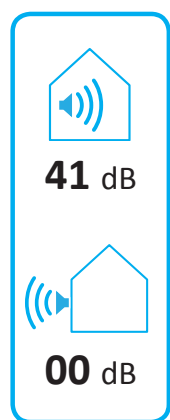

2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss

DHP-L Opti Pro+ 6



A++

A

+



+



X

+



X

+



A++



A

2015

811/2013




Danfoss DHP-L Opti Pro +8



A++



A



Danfoss DHP-L Opti Pro +8





55 °C

35 °C



A++

A++

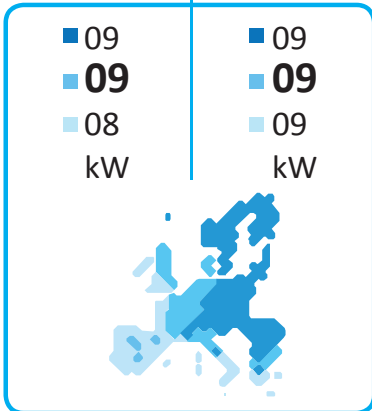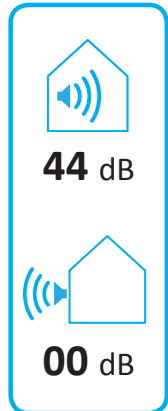

Danfoss DHP-L Opti Pro+ 8



A++



A



+



X

+



X

+



X

+



X



A++



A




ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss



DHP-L Opti Pro +10



A++

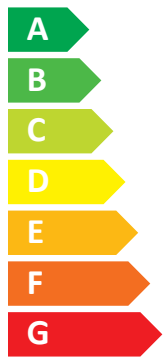

A



2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss

DHP-L Opti Pro +10





55 °C

35 °C



A++

A++

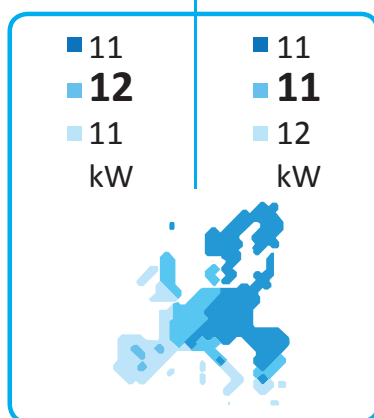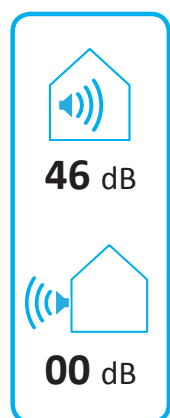

2015


811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss

DHP-L Opti Pro+ 10



A++



A

2015

811/2013




ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss



DHP-L Opti Pro +13



A++

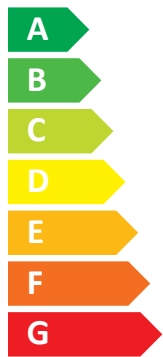

A



2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss

DHP-L Opti Pro +13





55 °C

35 °C



A++

A++

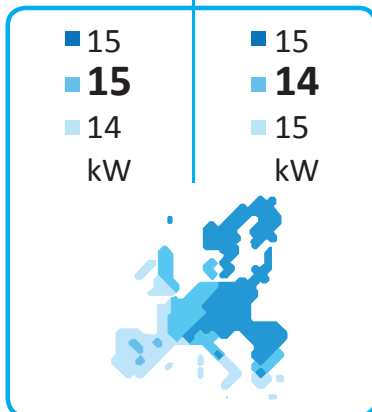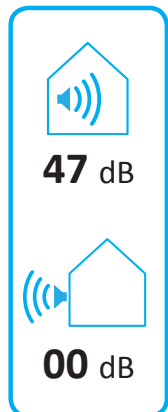

2015


811/2013




ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss

DHP-L Opti Pro+ 13



A++



A

2015

811/2013




ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss



DHP-L Opti Pro +17



A++

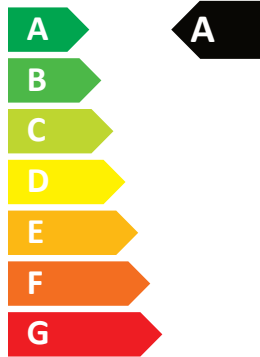

A



2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss

DHP-L Opti Pro +17





55 °C

35 °C



A++

A++

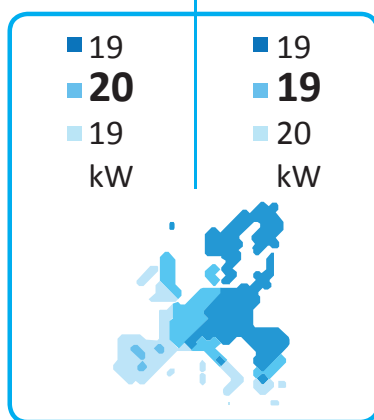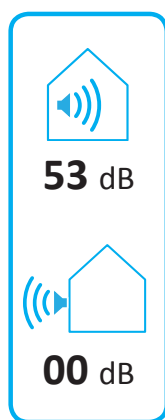

2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Danfoss

DHP-L Opti Pro+ 17



A++



A



A++

+



+



+



+



A

2015

811/2013